



# Product Guide

## HE Series...

## HE Series


*Premier Indoor Evaporator Coils*



# HE Series


## The Premier Upgrade for Any System...

Introducing Healthy Solutions® Premier Evaporator Coils by ADP. These coils match perfectly with your system, providing an upgrade over standard matched coils.

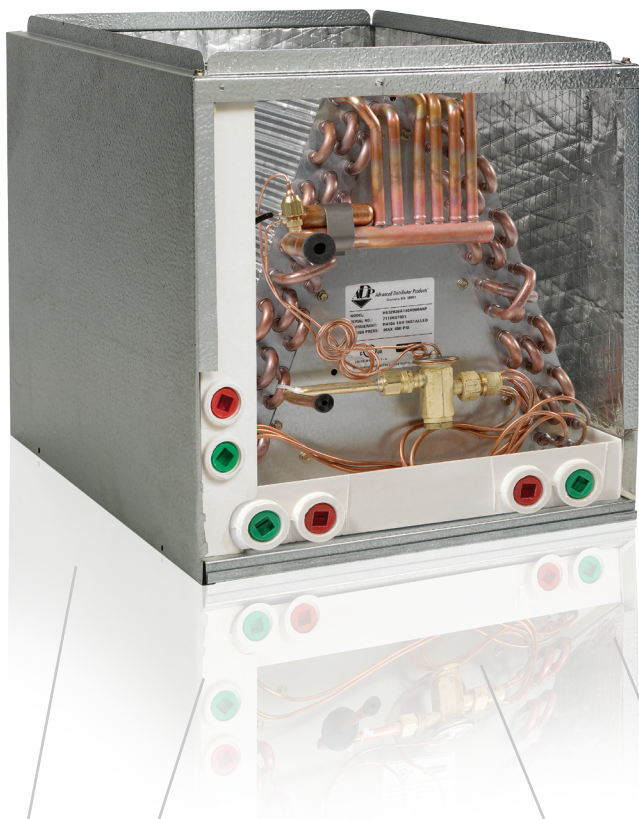

Intertek lab tested  
1% or less cabinet air  
leakage for better efficiency

Built-in plenum  
flanges with rounded  
corners for fast and  
safe installation

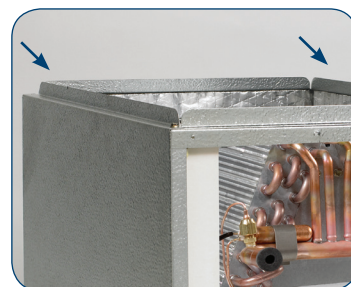

Front panel with only  
four screws for fast  
and easy coil access




Non-captive  
refrigerant lines

TXV with all threaded  
connections; no  
brazing required




HydroTEC™ drain  
pan design for lower  
water retention

Dual drain connections  
on each side for ease  
of installation

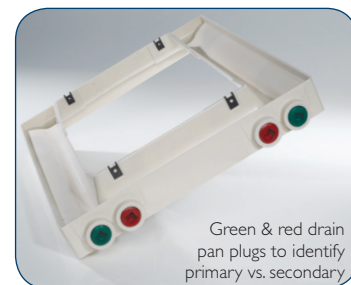

Green & red drain  
pan plugs to identify  
primary vs. secondary

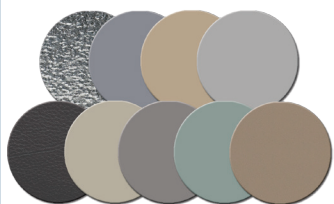

Painted cabinet  
options for furnace  
color coordination





## Improved Air Quality

Microbes can double every 20 minutes on an untreated surface!



Standard plastic pan  
with visible mold




Plastic pan with Microban®  
antimicrobial additive

Mold is part of our environment and there are no practical ways to completely eliminate mold spores. The best defense against mold in a home is to prevent it from taking hold through moisture control and the use of mold resistant building materials.

Every Healthy Solutions® coil features Microban® technology, providing added protection against the build-up of mold and mildew within your system!

## Lower Height

ADP provides space saving opportunities and a perfect fit with your furnace!

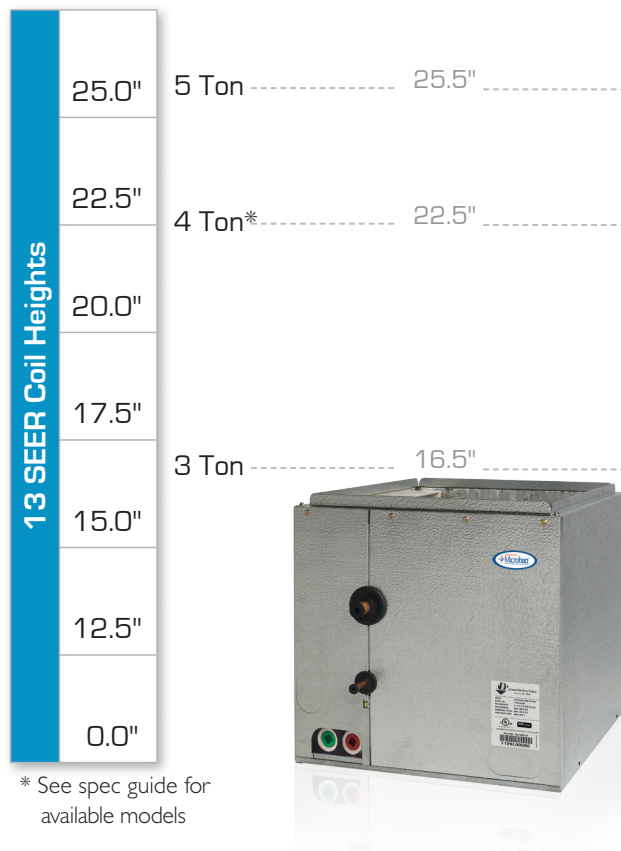

## The ADP Advantage...

### PROTECTION

ADP is the exclusive provider of coils featuring antimicrobial product protection by Microban®, a recognized consumer brand.

### QUALITY

ADP proprietary testing technology ensures leak-free performance at the higher operating pressures of R-410A systems.

### SERVICE

Healthy Solutions® coils are made for seamless installation and easy access.

### ENERGY SAVINGS

Many models are available to achieve higher SEER levels for ENERGY STAR compliance, utility rebates, and federal tax credits.

### WARRANTY

Healthy Solutions® coils feature an available 10-year limited warranty. Simply register online at [www.adpwarranty.com](http://www.adpwarranty.com).

# Product Nomenclature



Made in USA

**H E30 2 24 C 145 B 12 05 AP**

## Cabinet Color

H: Embossed  
A: Armstrong  
D: Ducane/Aire-Flo  
G: ICP  
J: Goodman/Amana  
L: Lennox  
N: Nordyne  
P: Carrier/Bryant/  
Payne  
R: Rheem/Ruud  
T: Trane/American  
Standard  
Y: York/Luxaire/  
Coleman

## Slab Number

E & A: Copper slab  
G & B: Aluminum slab

## Metering Device

1: Piston (R-410A)  
2: Piston (R-22)  
3: Bleed A/C TXV (R-22)  
4: Non-bleed A/C TXV (R-22)  
5: Non-bleed HP-A/C TXV (R-22)  
6: Non-bleed A/C TXV (R-410A)  
9: Non-bleed HP-A/C TXV (R-410A)

## Nominal MBTUH

## Cabinet Depth

A: Uncased  
C: 20.5"  
D: 21.0"  
E: 21.5"

## Width

Cased	Uncased
140: 14.00"	130: 13.00"
142: 14.25"	140: 14.00"
145: 14.50"	155: 15.50"
175: 17.50"	170: 17.00"
210: 21.00"	200: 20.00"
245: 24.50"	205: 20.50"
255: 25.50"	235: 23.50"
	251: 25.12"

## Piston Size<sup>[1]</sup>

AP: TXV access port<sup>[2]</sup>

MBTUH	R-22	R-410A
12:	41	41
18:	53	49
24:	59	53
30:	67	59
36:	73	67
42:	80	73
48:	84	76
60:	93	93

[1] Piston will be sized to match the nominal BTU rating of the coil

[2] TXV access port standard on factory installed TXVs; optional on piston models

## Product Code

00: Right-hand uncased  
01: Right-hand cased  
04: Left-hand uncased  
05: Left-hand cased  
20: Right-hand cased multi-position  
22: Left-hand cased multi-position

## Cabinet Height

00: Uncased  
12: 12.50"  
16: 16.50"  
18: 18.50"  
(Up to 31.5")

Note: Cabinet height not a selectable option, see cased dimensions

## Cabinet Upper Notch

A: Uncased  
B: 0.75" (standard)

Proudly distributed by:

2175 West Park Place Boulevard  
Stone Mountain, Georgia 30087  
www.adpnw.com

ISO 9001:2008  
—Registered Quality System—



SL-HAC-II  
April 2015